


SAN DIEGO AIR POLLUTION CONTROL DISTRICT COMPLIANCE DIVISION 10124 OLD GROVE ROAD SAN DIEGO CA 92131

PHONE (858) 586-2650 FAX (858) 586-2651

VR-201-202-XX Healy Quarterly Inspection

SOURCE INFORMATION and Inspection Date:						
Facility (DBA	L): Individual conducting inspection:					
Facility Stree	t Address: Affiliation:					
City/Zip:	P/O Number:					
Valve	<u>Clean Air Separator Inspection</u> Check One Box Below					
A	□Open □Closed					
В	□Open □Closed					
С	□Open □Closed					
D	□Open □Closed					
Plug						
Е	□Installed □Missing					
F	□Installed □Missing					

Clean Air Separator Normal Operating Configuration

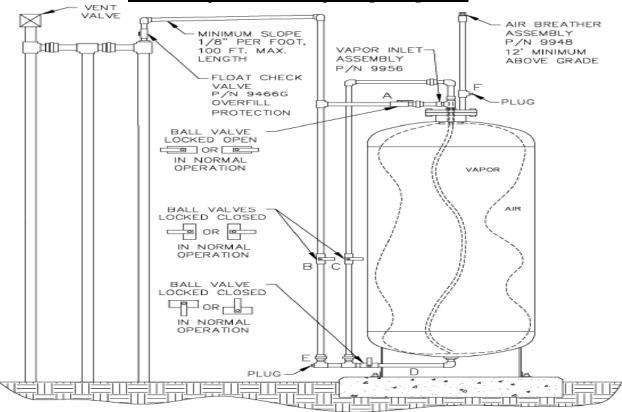

REV 03/21



SAN DIEGO AIR POLLUTION CONTROL DISTRICT COMPLIANCE DIVISION 10124 OLD GROVE ROAD SAN DIEGO CA 92131

PHONE (858) 586-2650 FAX (858) 586-2651

Verify that the Healy nozzle will not dispense fuel when the dispenser is authorized (ready to dispense fuel) and the boot is in a free state (uncompressed). To conduct this inspection, remove the nozzle from the dispenser, authorize the dispenser, and point the nozzle into an approved container (do not compress the mini-boot in any manner) and actuate the nozzle lever. No fuel should dispense. Any nozzle that dispenses fuel with the miniboot in a free state condition, as determined by this inspection procedure, shall be removed from service until repaired or replaced.

		_		
Nozzle #	Pass/Fail		Nozzle #	Pass/Fail

VP 1000 Vacuum Pump Inspection

Do the VP1000 vacuum pumps have loose or damaged vapor line connections? □YES □NO

(If copper tubing is kinked or loose remove the dispenser from service and call a Healy certified Technician for service)

REV 03/21 2